


INSIDE: 2010 ASHRAE Research Report

www.ashrae.org

October 2010

ASHRAE® JOURNAL

The magazine of the American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc.

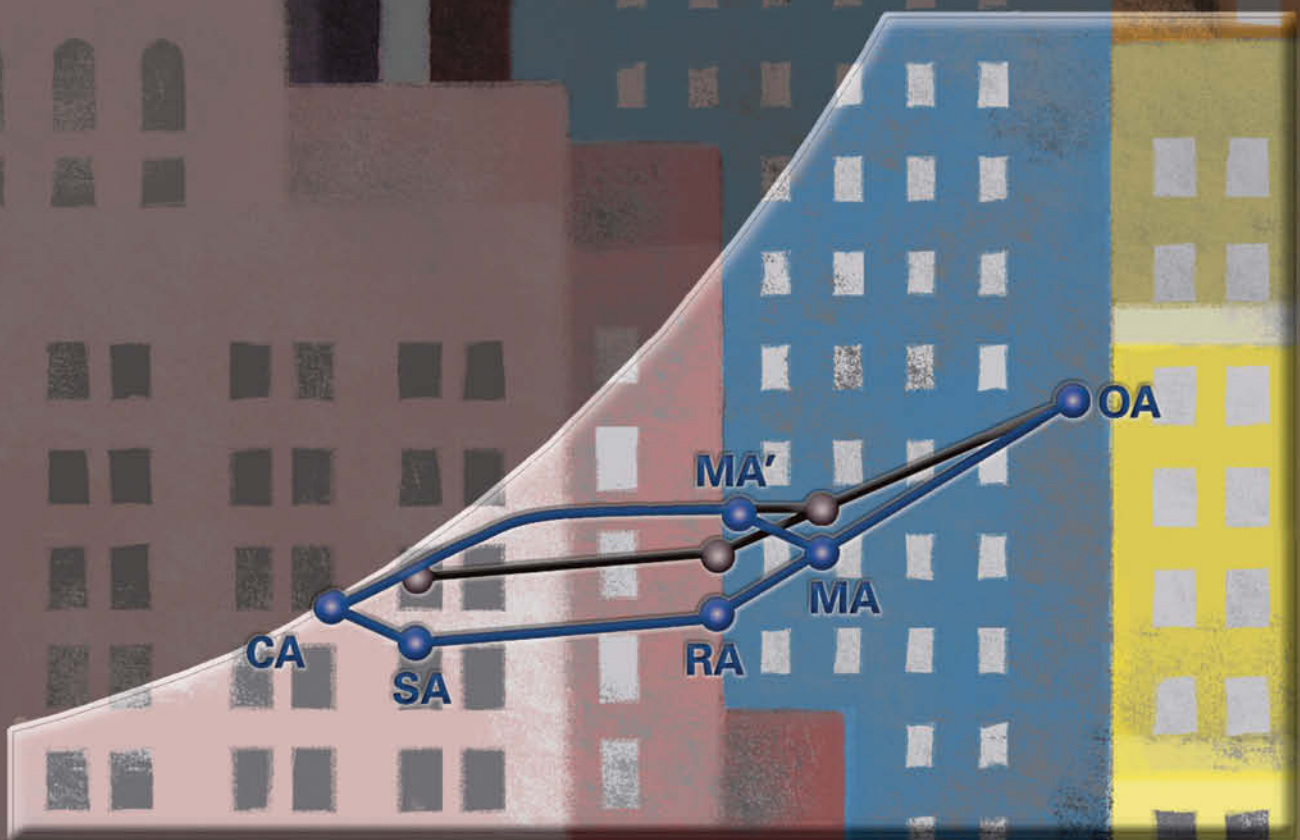

VAV and Humidity Effective Part-Load Strategies

A
L
S
O

- Cleanroom Energy Efficiency · Ultra-Low GWP Refrigerants
- HVAC for Prisons · Modeling Zero Energy · Personal Ventilation

CONTENTS

Vol. 52, No. 10 | October 2010



24



34



44

Features

18 Using VAV to Limit Humidity at Part Load
By John Murphy

24 Cleanroom Energy Efficiency
By Paul A. Mathew, Ph.D.; William Tschudi, P.E.; Dale Sartor, P.E.; James Beasley

34 Ultra-Low GWP Refrigerants
Global Regulations and Standards
By William Goetzler; Javier Burgos; Timothy Sutherland

2010 ASHRAE TECHNOLOGY AWARDS

44 HVAC for Prisons
By Surrander Naganathan, P.E.

Departments

- | | | | | | |
|---|---------------|----|------------------------|----|-------------------|
| 4 | Commentary | 16 | Meetings and Shows | 96 | Advertisers Index |
| 6 | Industry News | 92 | Special Products | | |
| 8 | Letters | 94 | Classified Advertising | | |

Standing Columns

65 Solar ZEB Project
Modeling Zero Energy
By Ty Newell and Ben Newell

70 Emerging Technologies
Personal Ventilation
By John Dieckmann; Alissa Cooperman; James Brodrick, Ph.D.

76 IAQ Applications
IAQ & High Performance
By Andrew K. Persily, Ph.D.; Steven J. Emmerich

84 Commissioning
The Right Measures
By Joan Effinger; Hannah Friedman, P.E.

90 Washington Report
Roadmap to Net Zero
By Mark Ames

Special Sections

52 ASHRAE Research Report

HR1 ASHRAE Honor Roll

ASHRAE® Journal (ISSN 0001-2491) **MISSION STATEMENT** | ASHRAE Journal reviews current HVAC&R technology of broad interest through publication of application-oriented articles. ASHRAE Journal's editorial content ranges from back-to-basics features to reviews of emerging technologies, covering the entire spectrum of professional interest from design and construction practices to commissioning and the service life of HVAC&R environmental systems. **PUBLISHED MONTHLY** | Copyright 2010 by the American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc., 1791 Tullie Circle N.E., Atlanta, GA 30329. Periodicals postage paid at Atlanta, Georgia, and additional mailing offices. **LETTERS/MANUSCRIPTS** | Letters to the editor and manuscripts for publication should be sent to: Fred Turner, Editor, ASHRAE Journal, fturner@ashrae.org. **SUBSCRIPTIONS** | \$8 per single copy (includes postage and handling on mail orders). Subscriptions for members \$6 per year, included with annual dues, not deductible. Nonmember \$59 (includes postage in USA); \$79 (includes postage for Canadian); \$149 international (includes air mail). Expiration dates vary for both member and nonmember subscriptions. Payment (U.S. funds) required with all orders. **CHANGE OF ADDRESS** | Requests must be received at subscription office eight weeks before effective date. Send both old and new addresses for the change. ASHRAE members may submit address changes at www.ashrae.org/address. **POSTMASTER** | Send form 3579 to: ASHRAE Journal, 1791 Tullie Circle N.E., Atlanta, GA 30329. Canadian Agreement Number 40037127.

ONLINE at ASHRAE.org | Feature articles are available online. Members can access articles at no cost. Nonmembers may purchase articles at www.ashrae.org/bookstore. | **CUSTOM ARTICLE REPRINTS** | Reprints are available from The YGS Group, call 800-290-5460 or Email ASHRAEreprints@theYGSgroup.com. **MICROFILM** | This publication is microfilmed by National Archive Publishing Company. For information on cost and issues available, contact NAPC at 800-420-NAPC or www.napubco.com. **PUBLICATION DISCLAIMER** | ASHRAE has compiled this publication with care, but ASHRAE has not investigated and ASHRAE expressly disclaims any duty to investigate any product, service, process, procedure, design or the like which may be described herein. The appearance of any technical data, editorial material or advertisement in this publication does not constitute endorsement, warranty or guarantee by ASHRAE of any product, service, process, procedure, design or the like. ASHRAE does not warrant that the information in this publication is free of errors and ASHRAE does not necessarily agree with any statement or opinion in this publication. The entire risk of the use of any information in this publication and its supplement is assumed by the user.